
NOTES:

 $\overline{\mathsf{X}}$

- ALL WORK MUST CONFORM WITH THE CURRENT INTERNATIONAL BUILDING CODE (IBC).
- ALL CONTRACTORS MUST VERIFY THE CONDITIONS AND DIMENSIONS AT THE SITE BEFORE STARTING WORK. INFORM ENGINEER OF ANY DISCREPANCIES IMMEDIATELY.
- TEMPORARY SUPPORTS ARE NOT INDICATED ON THESE DRAWINGS AND ARE THE RESPONSIBILITY OF THE CONTRACTOR PERFORMING THE WORK. HE SHALL ENGAGE AN ENGINEER FOR THIS PURPOSE, AS APPLICABLE.

IMPORTANT: FOOTINGS THAT ARE NOT INSTALLED BELOW THE FROST LEVEL ARE SUBJECT TO FROST HEAVING. AND MUST BE ACCOUNTED FOR IN FINAL DESIGN CONCEPT.

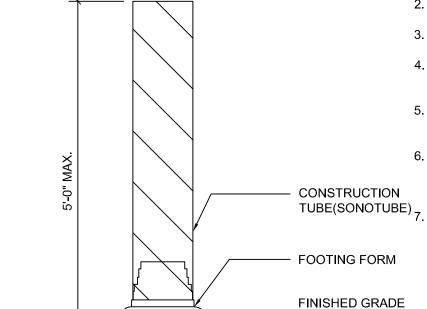

NOTES: ABOVE GROUND APPLICATION

- THE TOTAL COMBINED HEIGHT OF SOUND FOOTINGS [™] FOOTING FORM MUST NOT EXCEED 5'-0"
- DRILL 3/8" HOLE AT 45° ANGLE AT TWELVE LOCATIONS (SEE PATTERN BELOW)
- 3. DRIVE A 12" SPIKE THROUGH 3/8" HOLE AT A 45° ANGLE INWARDS
- TUBES MUST BE BRACED ONCE THE COMBINED HEIGHT EXCEEDS 3'-0" ABOVE GROUND.
- 5. SCAB BOARDS ARE FASTENED TO THE CONSTRUCTION TUBE WITH 1 1/4" WOOD SCREWS FROM THE INSIDE OF THE TUBE
- 6. SOUND FOOTINGS™ FOOTING FORM MUST BE PLACED ON UNDISTURBED SOIL OR COMPACTED GRAVEL(TO BE SPECIFIED BY GEOTECHNICAL ENGINEER) CHECK ALIGNMENT OF CONSTRUCTION TUBE BEFORE PLACING CONCRETE.

12" SPIKE

LOCATIONS TYP.

12" SPIKE @ 45° TYP. 1'-10" UNDISTURBED SOIL OR COMPACTED GRAVEL (TO BE SPECIFIED BY GEOTECHNICAL ENGINEER) SOUND FOOTINGS SF-22 FOOTING

FORM ABOVE GROUND APPLICATION

3/4" = 1'-0"



SOUND FOOTINGS FOOTING DETAIL SOUND FOOTINGS, LLC

DATE: 03/29/2019

DWG NUMBER: S100

